


施工箇所位置図

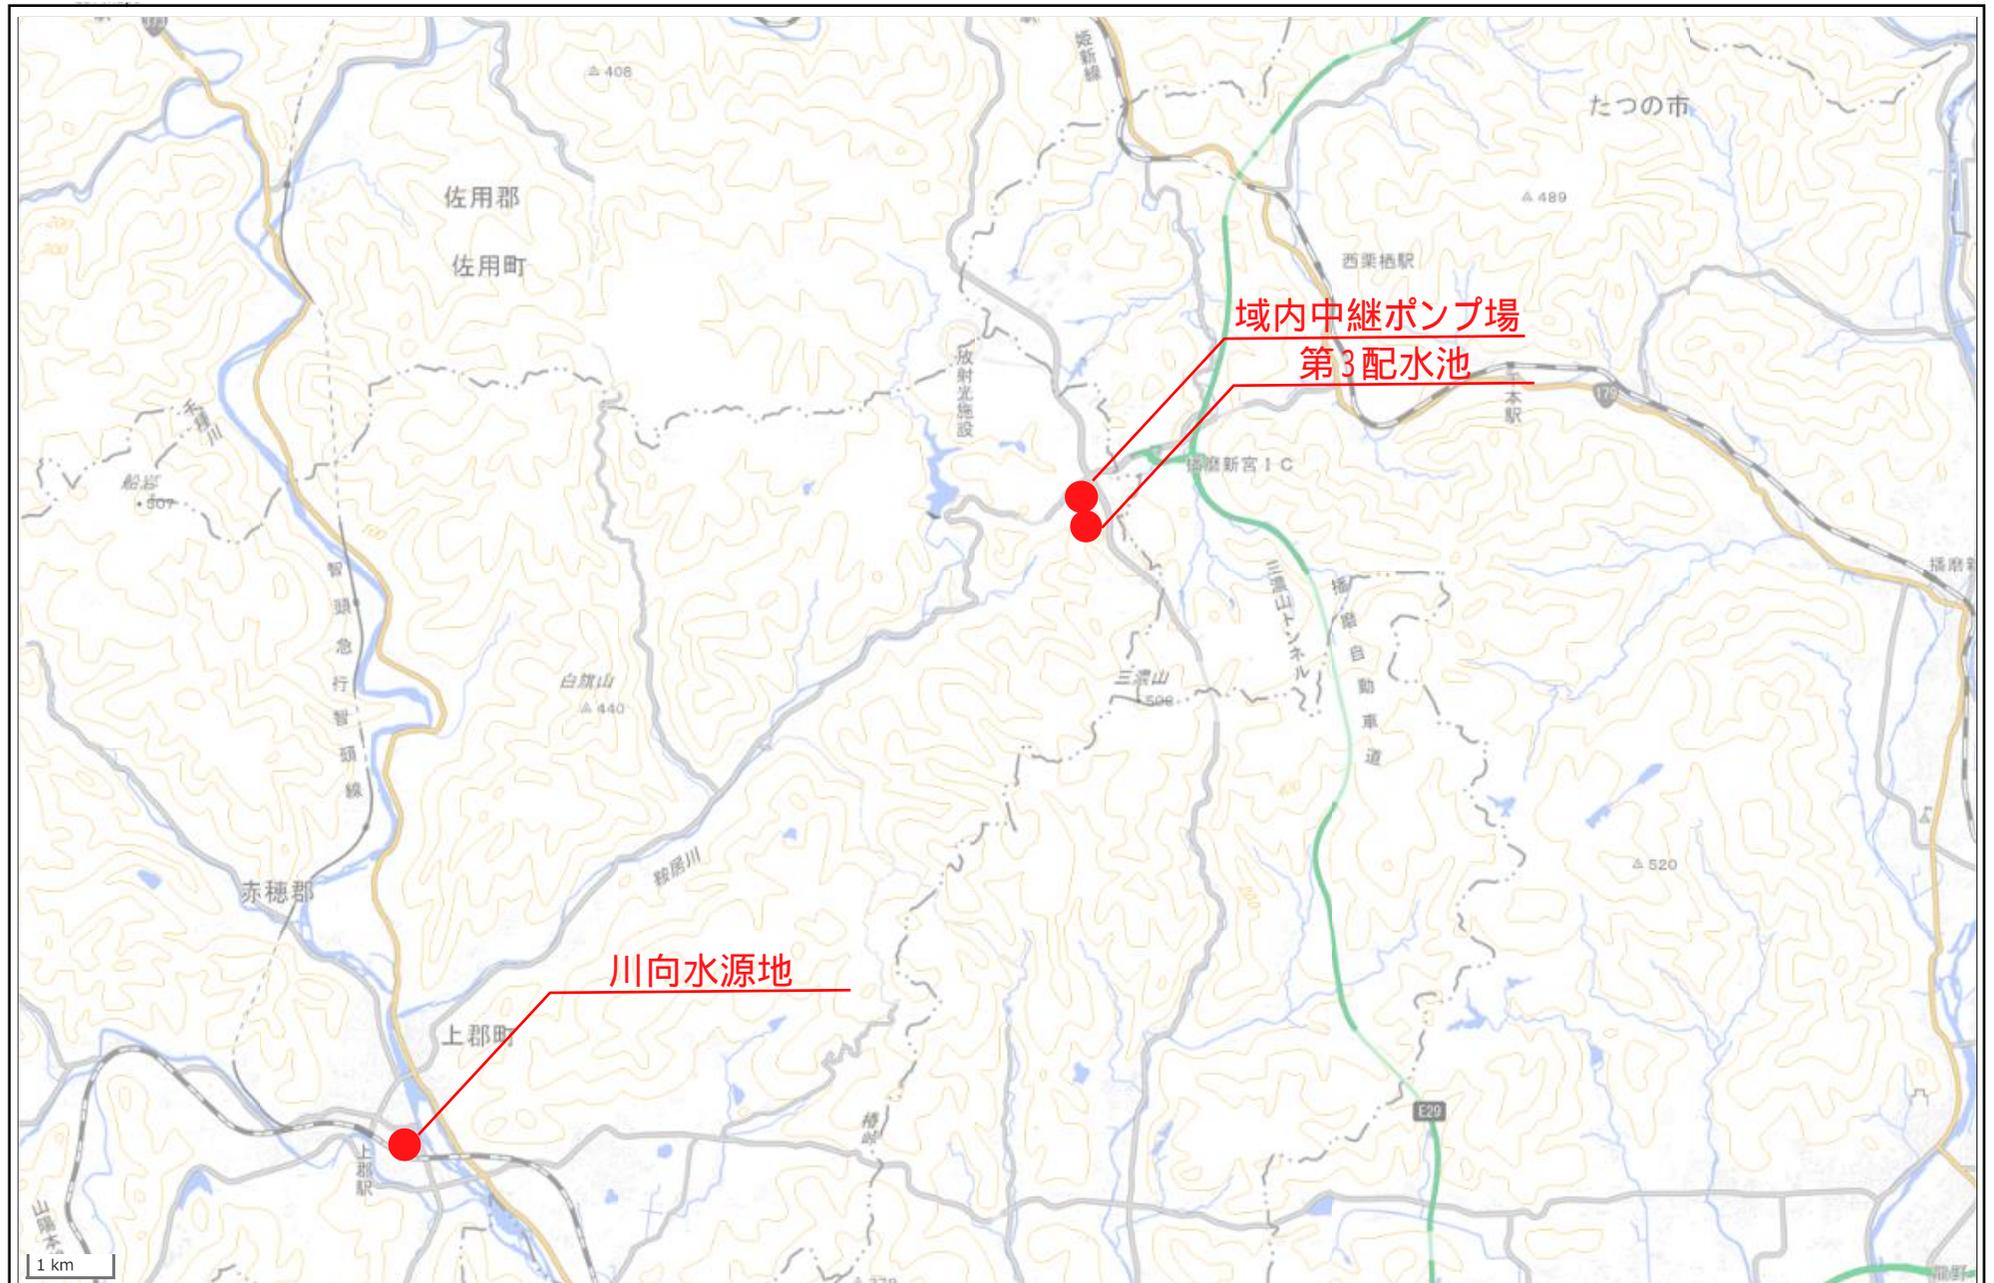


出典: 国土地理院ウェブサイトを加工して、播磨高原広域事務組合作成
(<https://maps.gsi.go.jp/#13/34.913666/134.431458/&base=pale&ls=pale&disp=1&vs=c1g1j0h0k0l0u0t0z0r0s0m0f0>)

(別途機械設備)



<C17>

<KP>

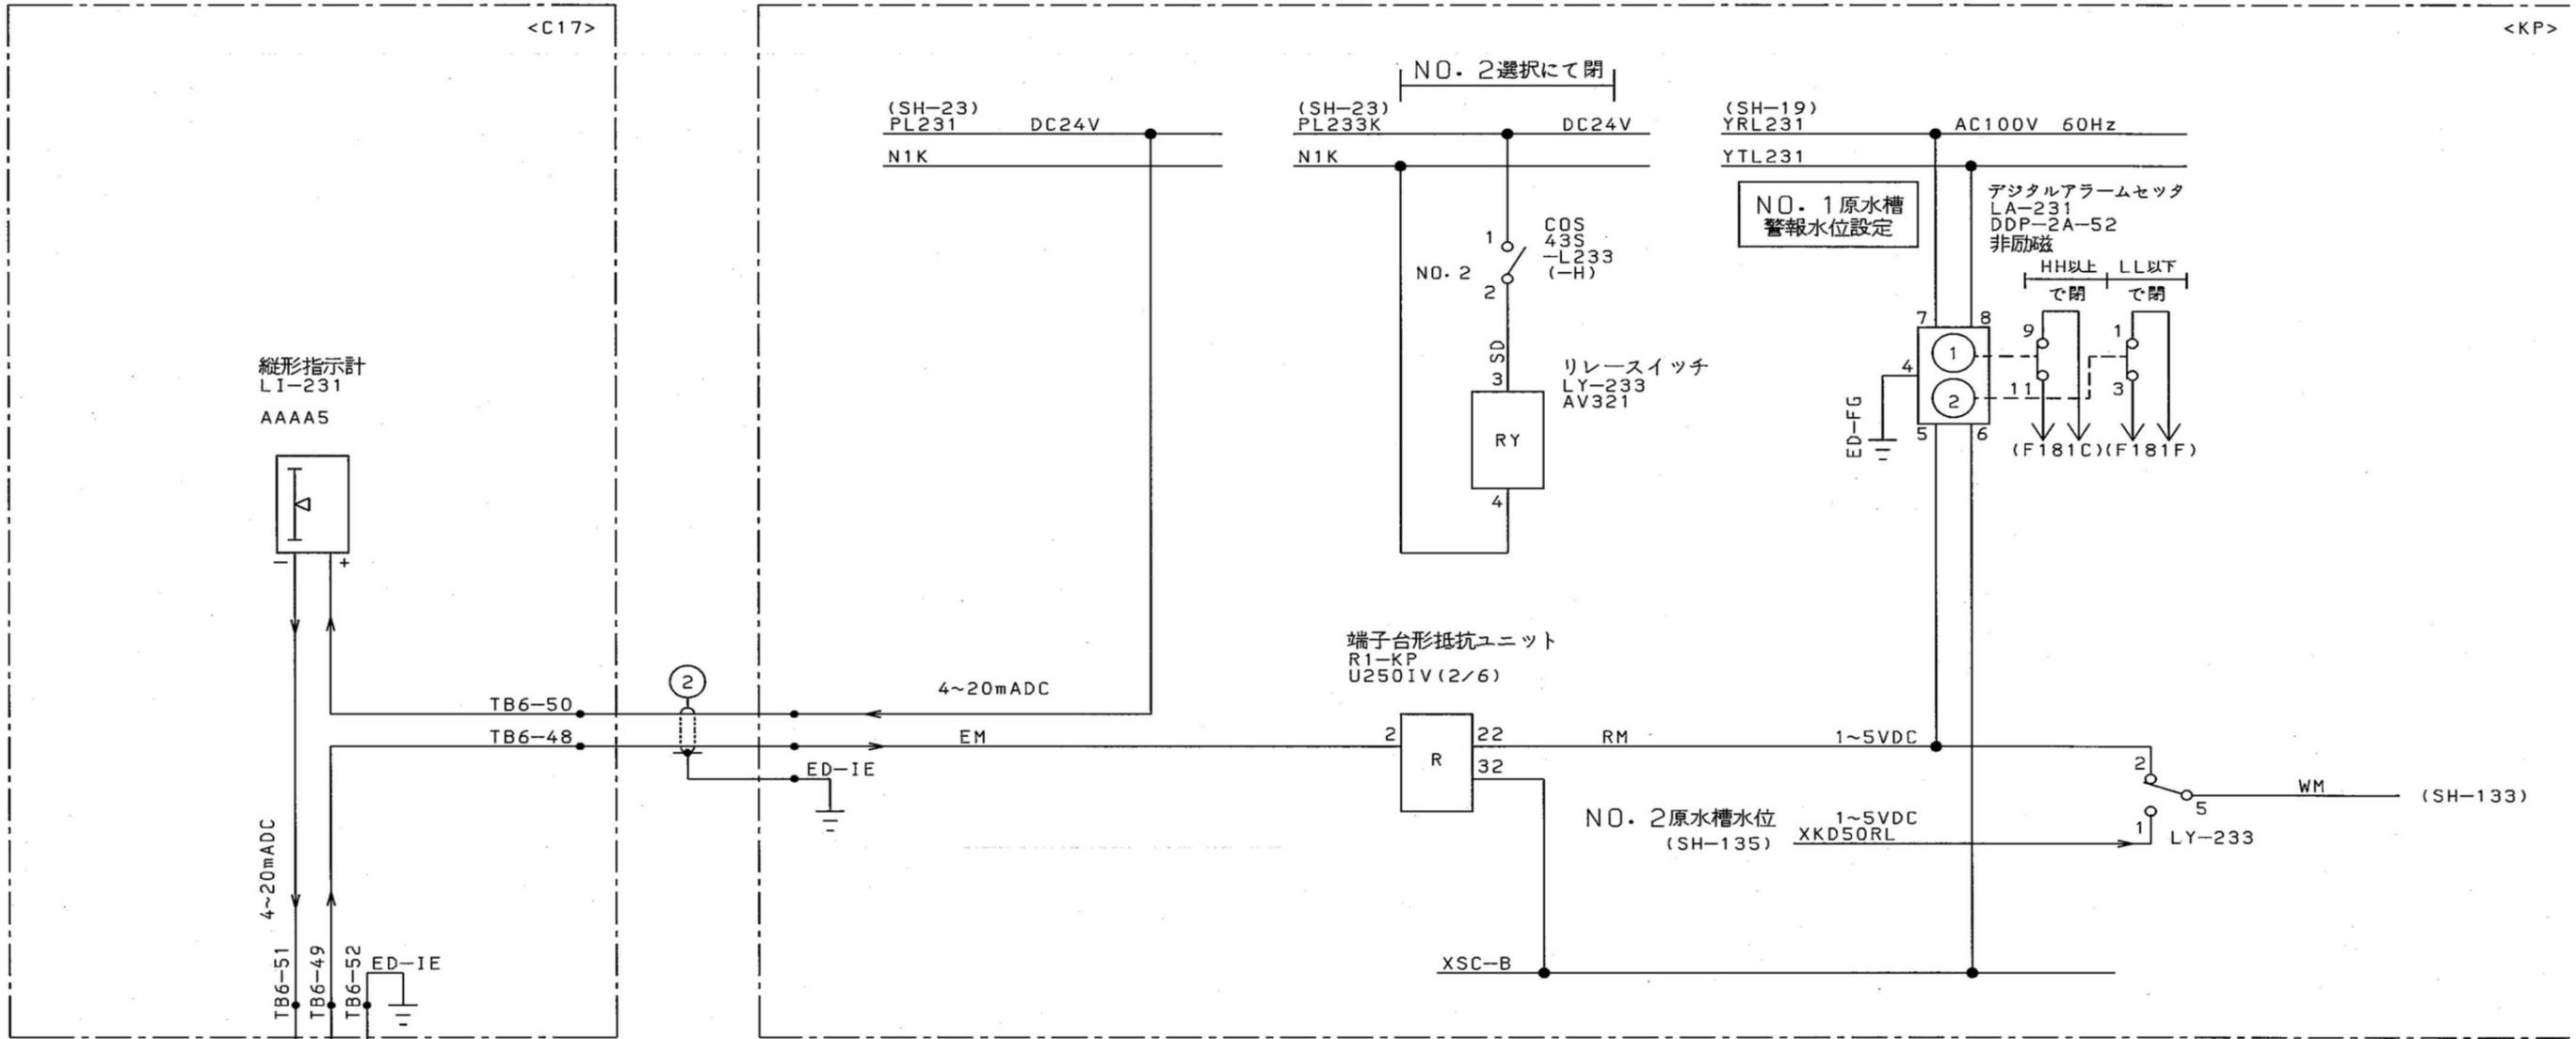

接点容量 (AV321) ;
 100VAC以下, 0.05A以下
 100VDC以下, 0.05A以下


接点容量 (DDP-□) ;
 250VAC, 1A以下
 100VDC, 0.2A以下

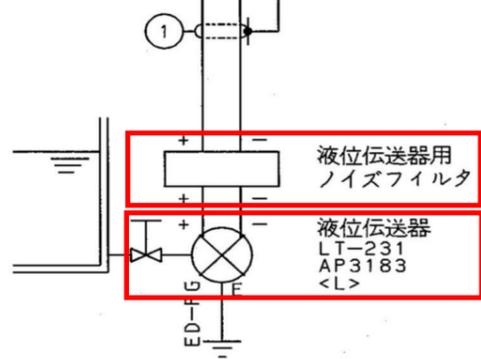



43S-L233
 BH-H1101
 1a1b
 (盤内取付)

指標	ケーブル符号	芯数	FROM LOC	TO LOC
1	KD2X01	2	L	C17
2	KD2X02	2	KP	C17

今回工事(既設撤去含む)

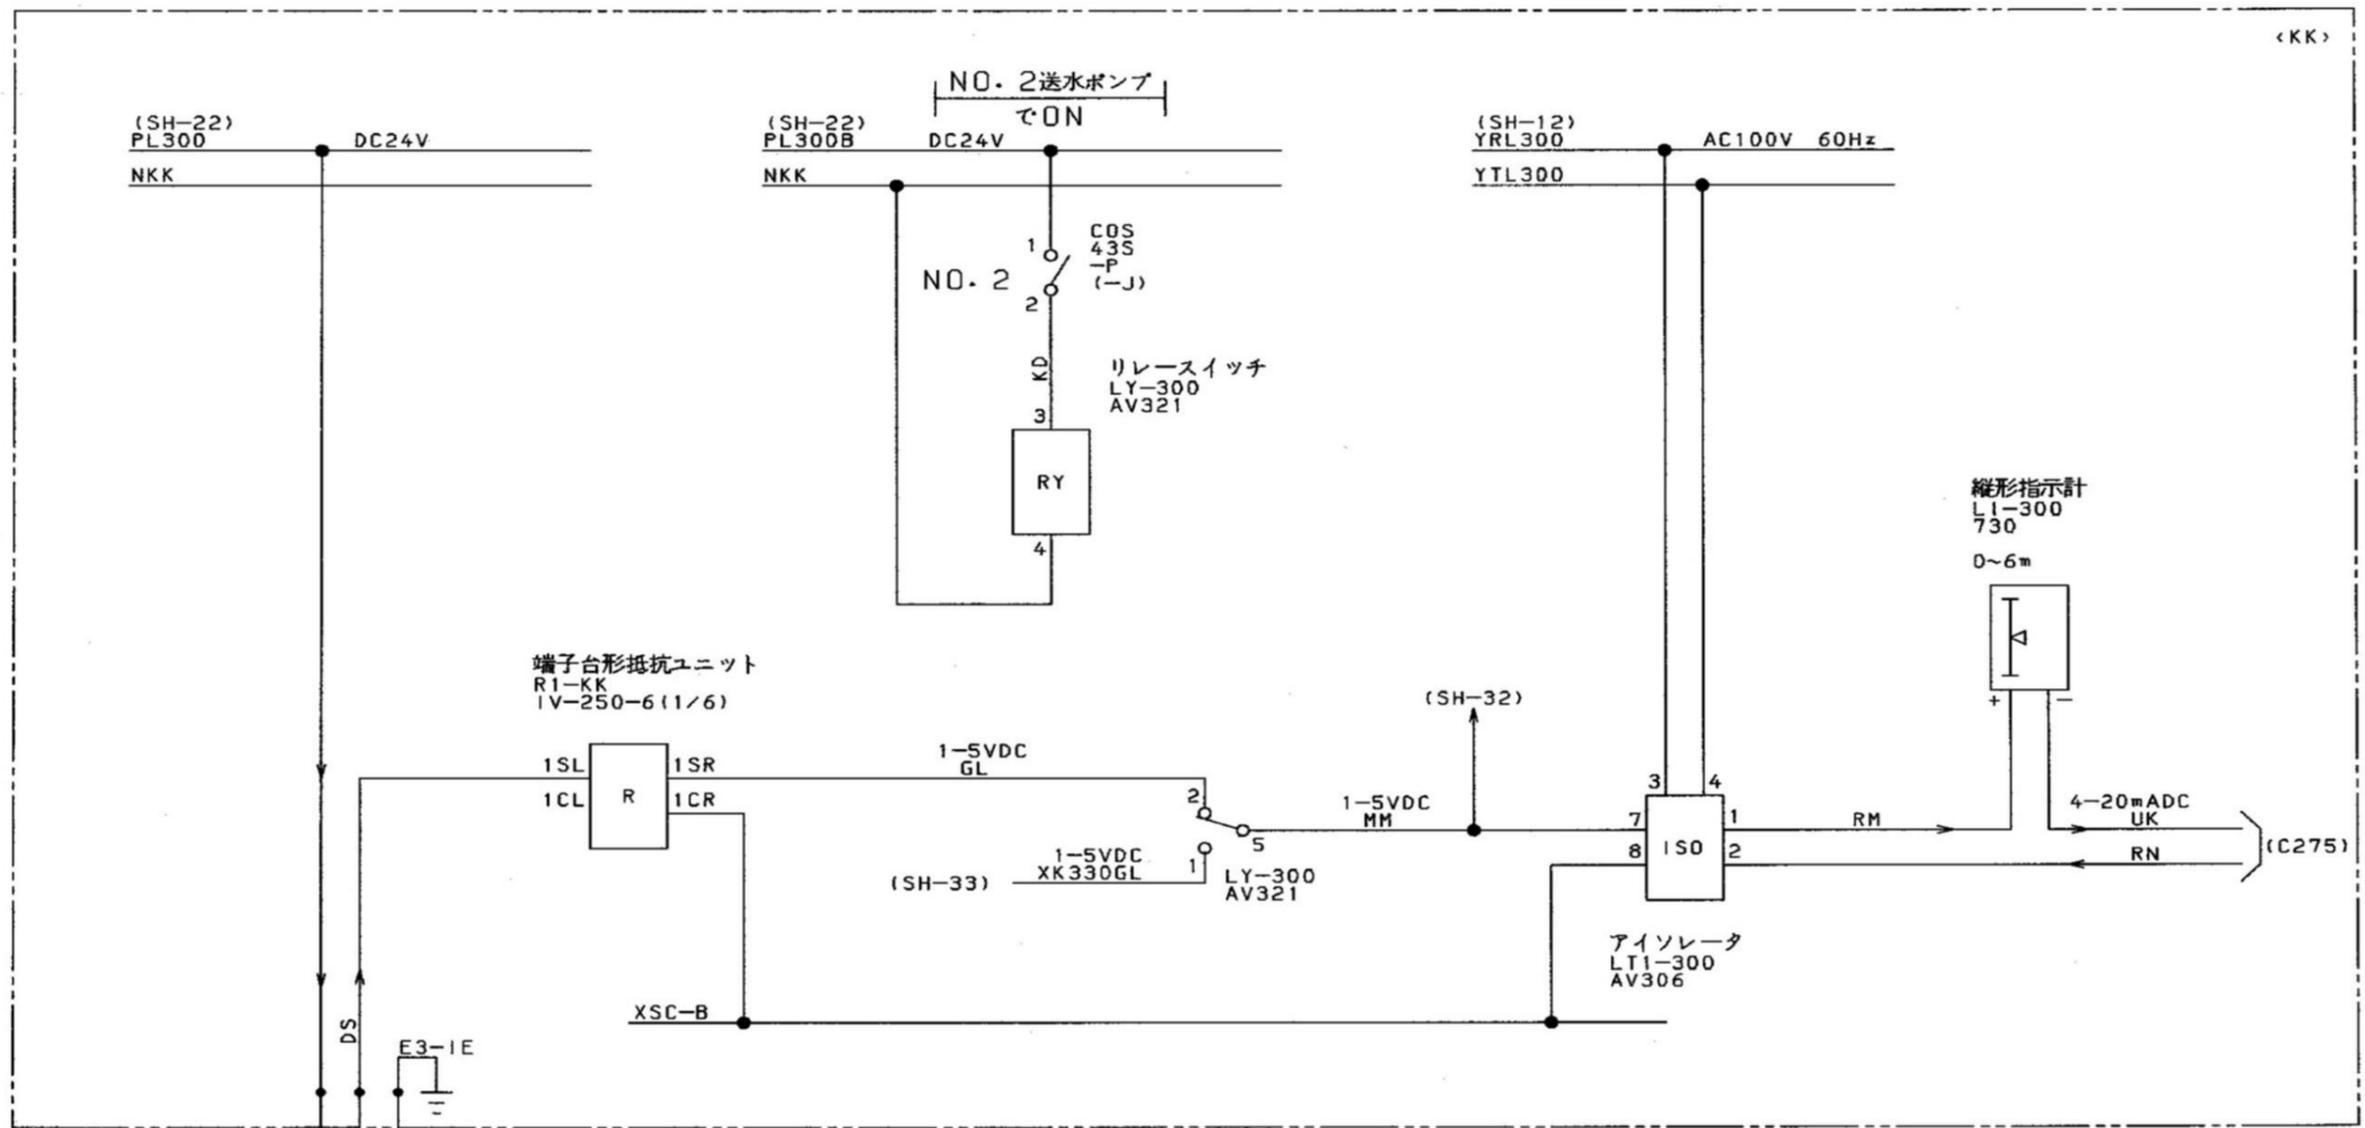


接点容量 (AV321) ;
 100VAC以下, 0.05A以下
 100VDC以下, 0.05A以下

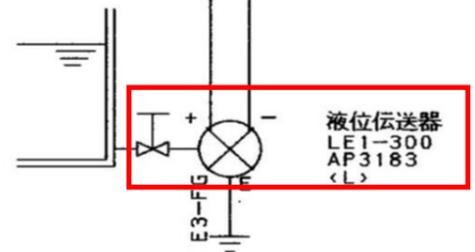



指標	ケーブル符号	芯数	FROM LOC	TO LOC
1	K31X01	2	KK	L

今回工事 (既設撤去含む)

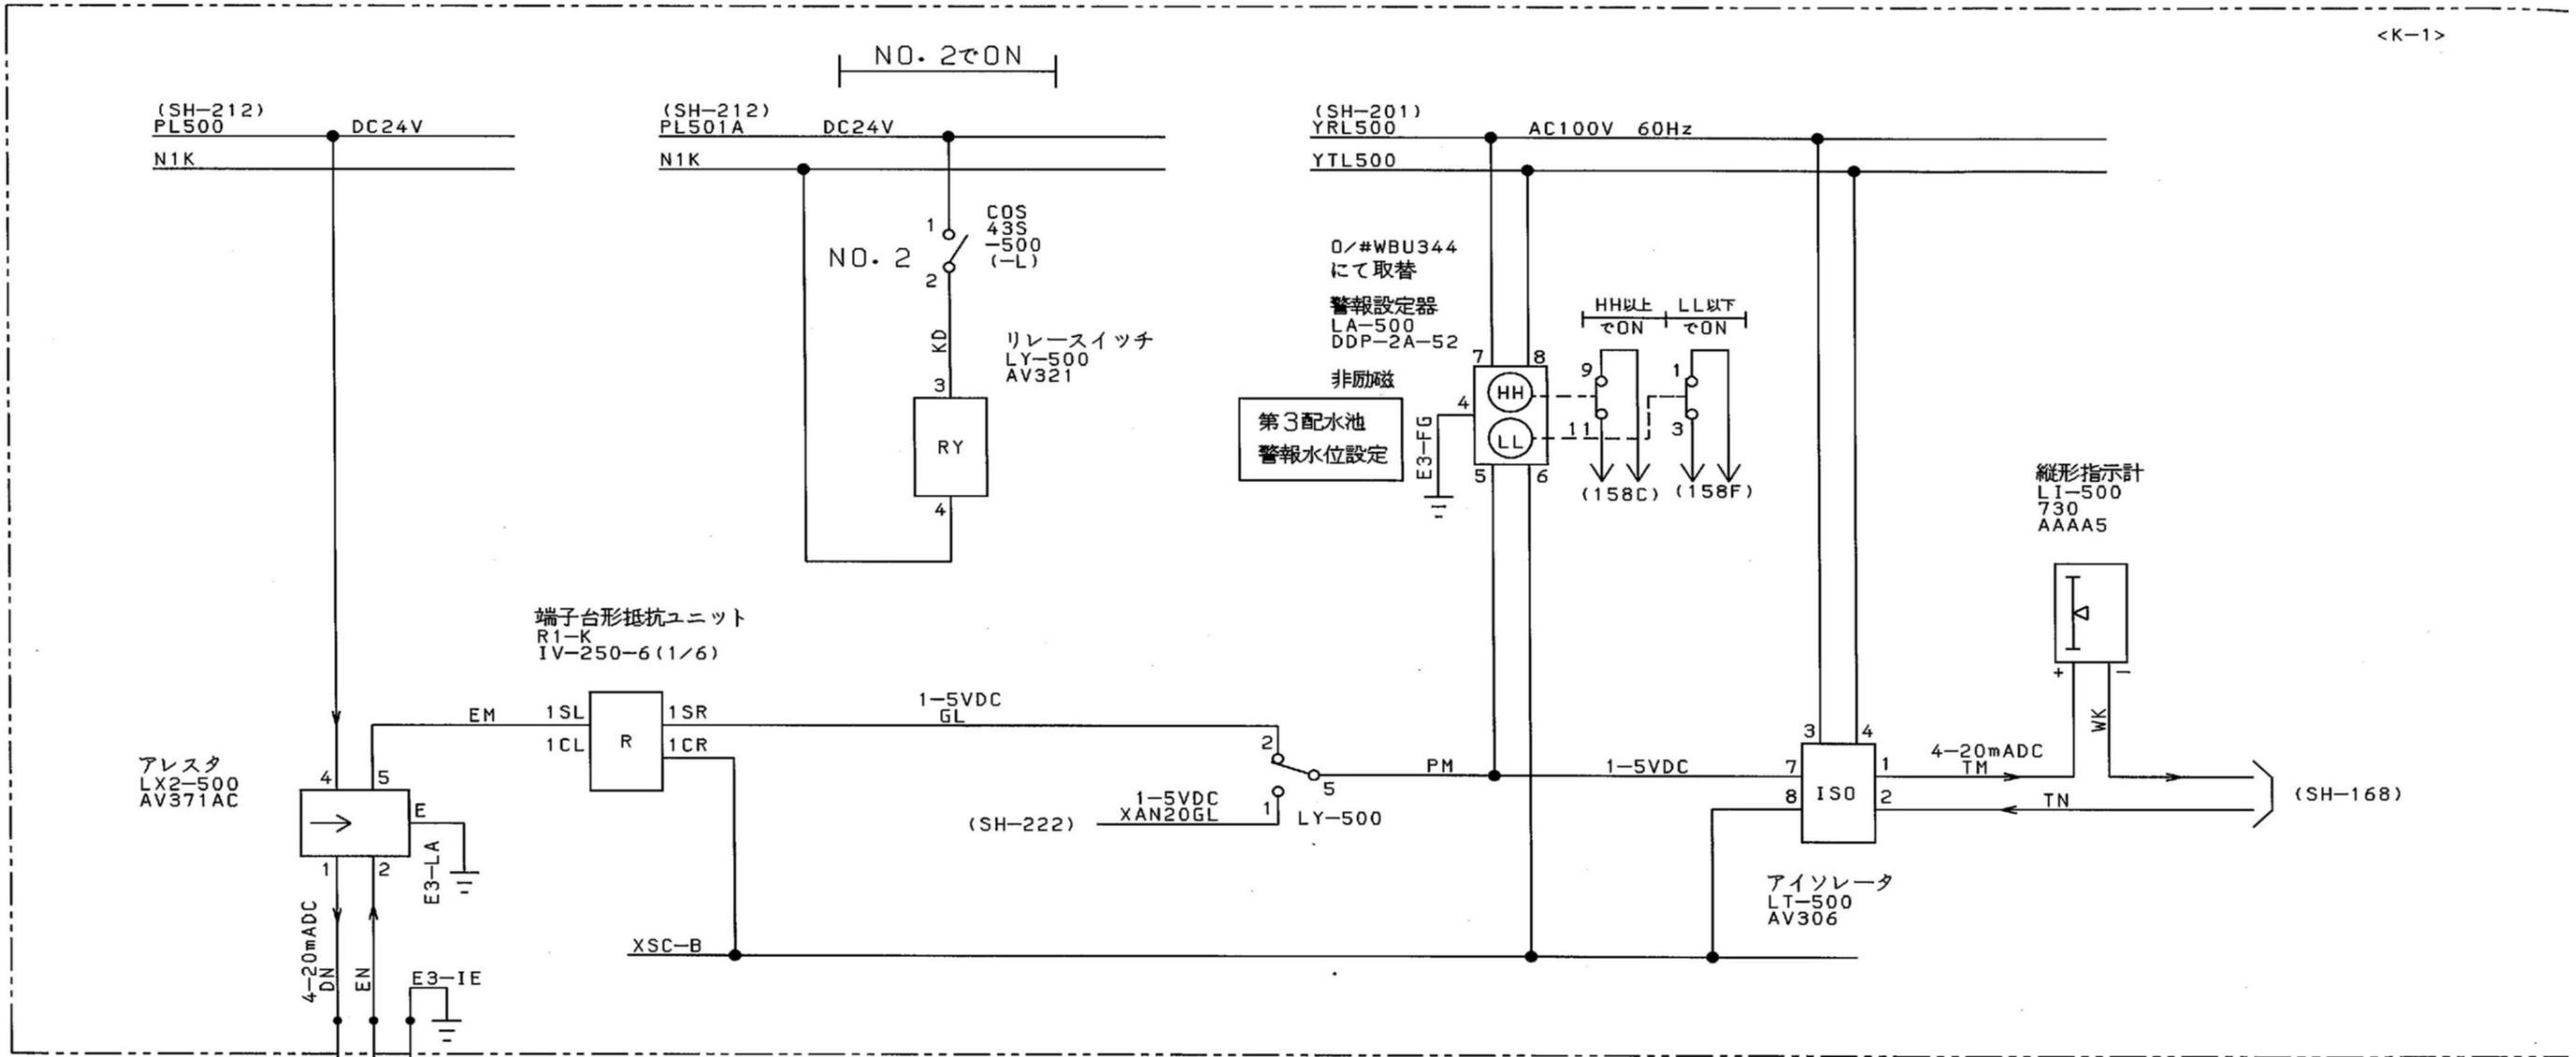

接点容量 (AV321) ;
100VAC以下, 0.05A以下
100VDC以下, 0.05A以下


接点容量 (DDP-2A-52) ;
250VAC, 1A
100VDC, 0.2A



43S-500
BH-H2103
2(1a1b)

(*)印は、屋外ケース収納

指標	ケーブル符号	芯数	FROM LOC	TO LOC
1	AN1X01	2	K-1	L
2	AN1X02	2	L	L

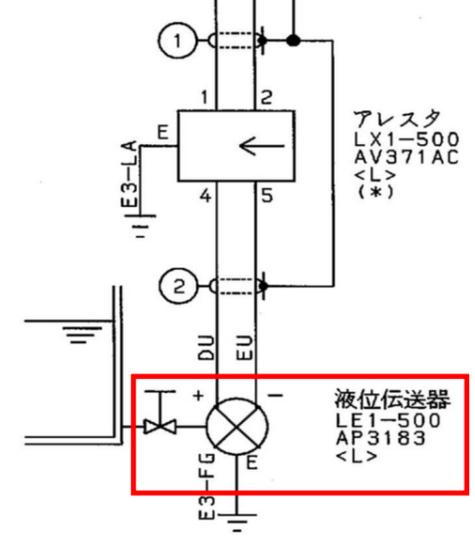

今回工事(既設撤去含む)